



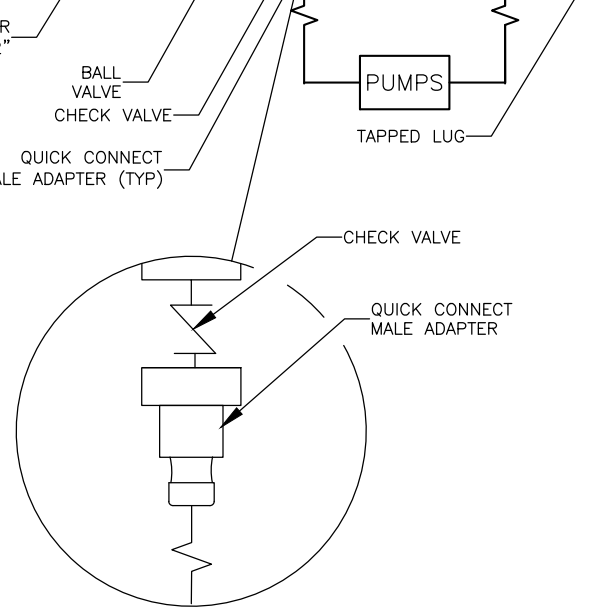

**PRE-TEST BACKFLOW PREVENTION  
ASSEMBLY**

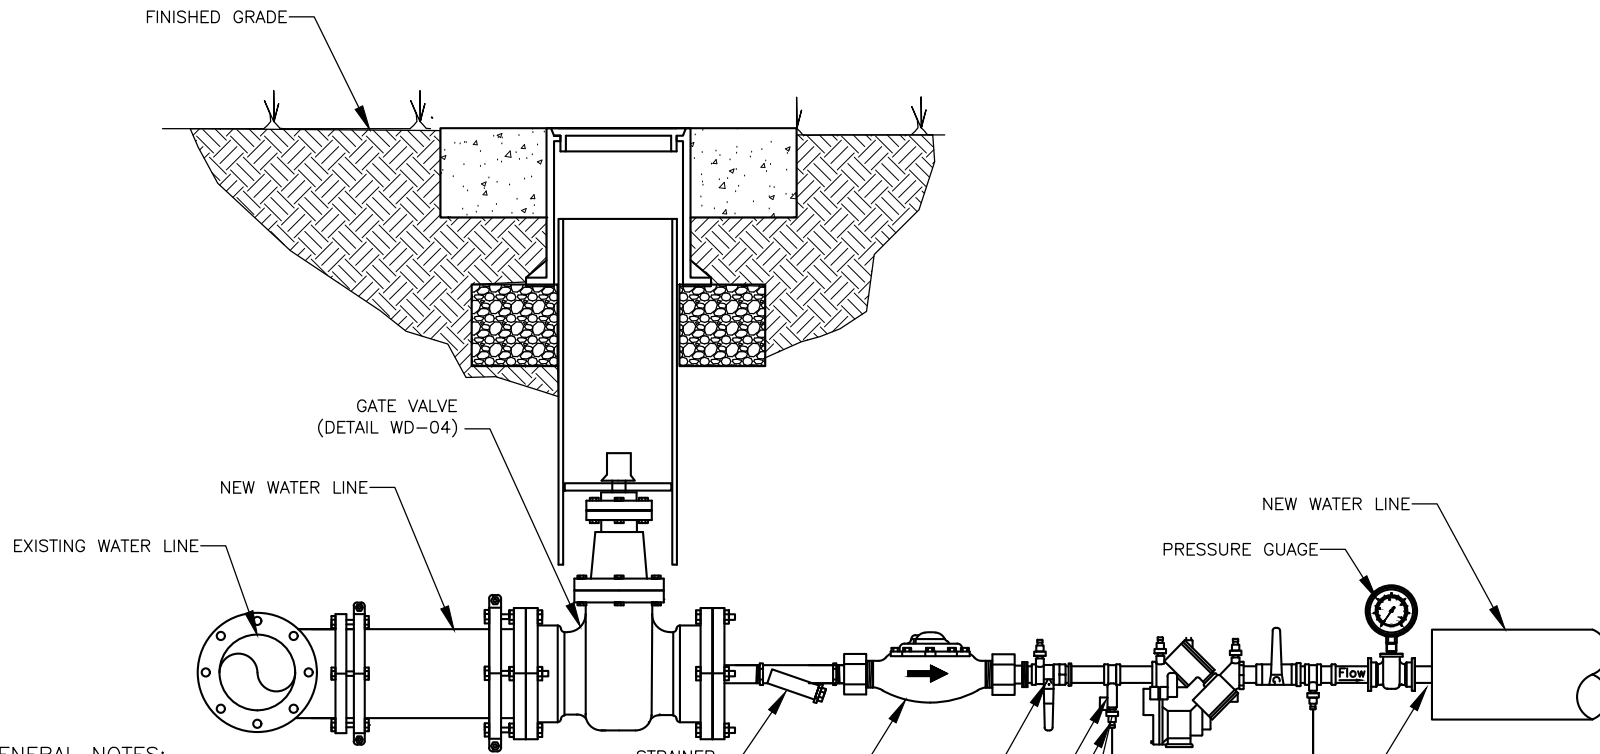

**GENERAL NOTES:**

1. PRIOR TO CONNECTING TO THE EXISTING WATERLINE, THE NEW WATER LINE WILL BE PRESSURE TESTED, DISINFECTED, CLEAR WATER SAMPLES OBTAINED, ALONG WITH APPROVAL OF RESULTS BY THE CITY OF HENDERSONVILLE.
2. ALL WATER FOR FILLING AND FLUSHING OF THE NEW WATER LINE WILL BE DRAWN THROUGH THE DOUBLE CHECK VALVE ASSEMBLY.
3. THE COSTS FOR PROVIDING DOUBLE CHECK VALVE ASSEMBLY AND SLEEVE NECESSARY FOR FINAL CONNECTION WILL BE INCIDENTAL TO THE WATER LINE INSTALLATION. NO SEPARATE PAYMENT WILL BE MADE.
4. THE CONTRACTOR WILL BE REQUIRED TO HAVE THE WATER METER TESTED TO MEET ACCURACY STANDARDS OF AWWA C700. NO SEPARATE PAYMENT WILL BE MADE. THE METER MUST BEAR A CERTIFICATION TAG AT ALL TIMES.
5. TRACER WIRE NOT SHOWN FOR CLARITY. WIRE SHALL BE INSTALLED PER CITY STANDARD DETAILS.

**DATE: 07/14/2025**    **WD DWG. NO. 15**

**SCALE: NOT TO SCALE**

City of Hendersonville Engineering Department  
 305 Williams Street  
 Hendersonville, NC 28792  
 (828) 697-3000 (office)  
[www.cityofhendersonville.org](http://www.cityofhendersonville.org)